LIGHTING	120VAC / 60hz / 1PH
CONTROL	480VAC / 60hz / 3PH
FAN (5)	5 HP EACH

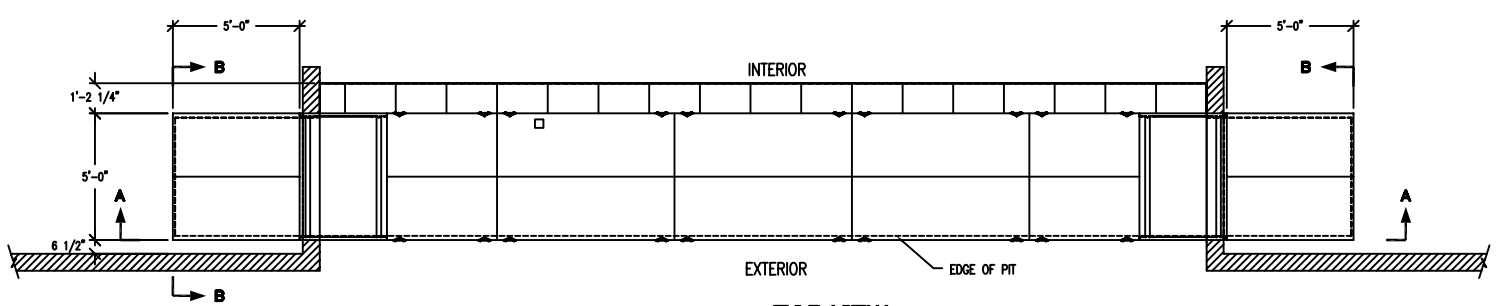

TOP VIEW
N.T.S

NOTES:

GENERAL

THE EQUIPMENT, INSTALLATION, AND WORK PERFORMED MUST CONFORM TO ALL APPLICABLE LOCAL AND NATIONAL CODES.

INSTALLATION

1. STEEL FRAME EMBEDDED IN CONCRETE.
2. TOWER (VERTICAL DUCT) AND PLENUM ARE MODULAR AND MAY BE INSTALLED AFTER THE WALLS ARE FINISHED.
3. ELECTRICAL CONNECTION TO BE PERFORMED BY A QUALIFIED LICENSED CONTRACTOR. (480VAC/60hz/3PH TO UNIT, 120VAC/60hz/1PH TO LIGHTING.
4. INSTALL RAISED ACCESS FLOOR PRIOR TO COMPLETION.

PARTS INCLUDED

1. RAISED ACCESS FLOORING INCLUDES:
   - A. FLOOR PANELS.
   - B. FLOOR PEDESTALS.
   - C. MOUNTING HARDWARE.
2. TOWER (MODULAR) INCLUDES:
   - A. SHEET METAL DUCT (PAINTED)
   - B. CONTROL
     1. TRANSFORMER
     2. PROCESSOR
     3. BREAKER (MAIN)
     4. 3 POSITION SWITCH
     5. CONTACTORS
     6. ENCLOSURE
   - C. FILTERS: 16" X 24" X 4"
3. PLENUM (MODULAR) INCLUDES:
   - A. 35'-0" FAN SECTION (PAINTED)
   - B. LIGHTING (FLUORESCENT)

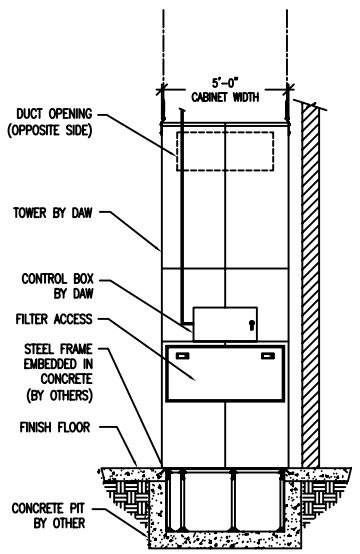

SECTION B-B
N.T.S

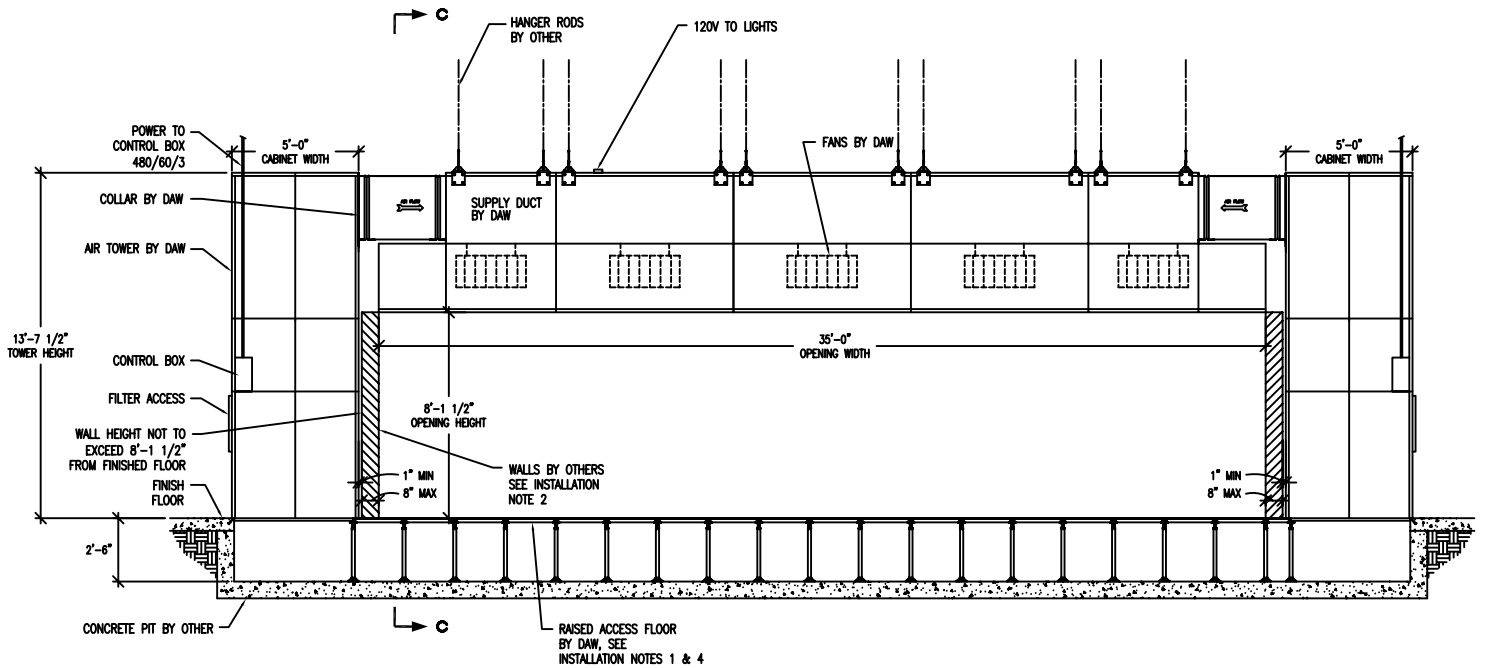

SECTION A-A
N.T.S

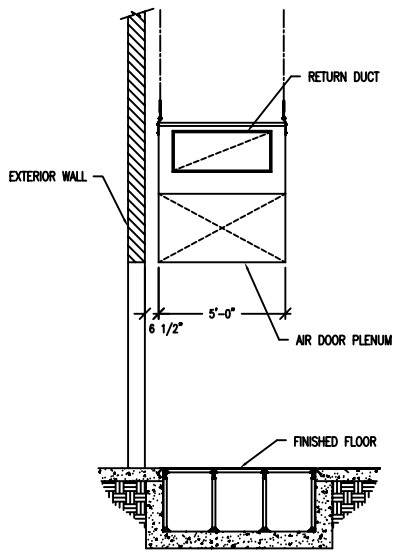

SECTION C-C
N.T.S

THIS DRAWING, AND THE INFORMATION SHOWN THEREON, IS THE SOLE PRODUCT OF DAW TECHNOLOGIES INC. NOR IS ANY REPRODUCTION AUTHORIZED WITHOUT THE EXPRESSED WRITTEN PERMISSION FROM DAW TECHNOLOGIES INC. – PATENTS PENDING
WHICH IT WAS SPECIFICALLY FURNISHED BY DAW TECHNOLOGIES INC. NEITHER THE DRAWING NOR SUCH INFORMATION IS TO BE USED FOR ANY SUCH PURPOSE OTHER THAN THAT FOR

KEYPLAN

NO.	REVISION OR ISSUED FOR	BY:	DATE:
0	Submittals	TW	3/28/05

Project:
ENVIROZONE
AIR ENTRANCE

NO HEAT
35'-0" UNIT

DAW TECH
1600 West 2200 South
Suite #201
Salt Lake City, Utah 84119

TITLE:
ASSEMBLY AND INSTALLATION DETAILS

DRAWN BY:	DATE:	CHECKED BY:	DATE:
T. Webb	3/28/05	–	–

SCALE: AS NOTED
JOB NO.: –
CAD. NO.:

SHEET NUMBER:
A.01